



Multi-Pure's Superior Performance Confirmed by Testing and Certification

The effectiveness of any drinking water treatment device is measured by the performance of its filter. NSF testing in accordance with NSF/ANSI standards provides the consumer with the highest level of assurance that certified products will perform as claimed. A close review of NSF Listings shows that Multi-Pure's solid carbon block filters are the most effective for reducing a broad spectrum of contaminants of aesthetic as well as health concern.


NSF Listings by Standard

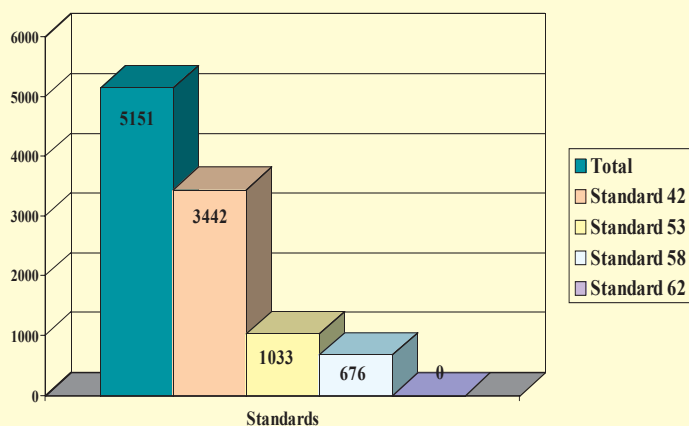

NSF Listings by Single Contaminant

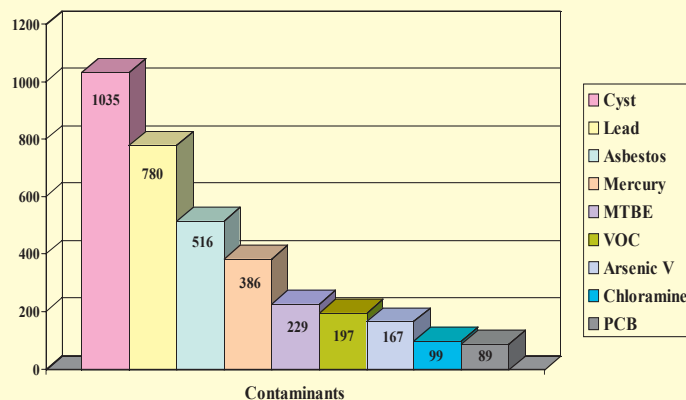

Listings by Combinations of Contaminants

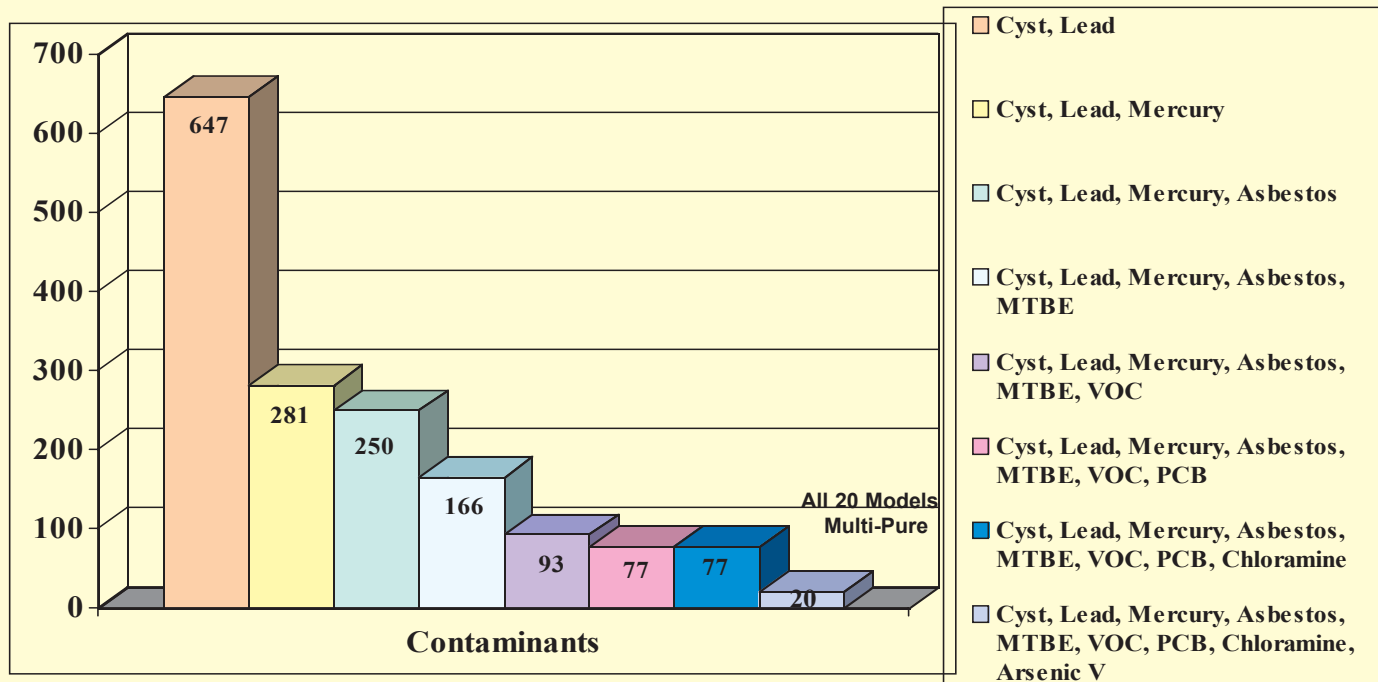

Comparing Drinking Water Systems Certified Performance Says It All

Testing programs and standards developed by NSF International provide a basis for evaluating and comparing drinking water treatment units. Although thousands of drinking water systems have been tested and certified, only a few are certified to reduce a wide range of contaminants. These charts summarize NSF Listings by standard, by single contaminants, and by combinations of contaminants.

Only Multi-Pure Drinking Water Systems are certified to reduce Lead, Mercury, Cyst, Asbestos, VOC, MTBE, PCB, Chloramine, and Arsenic V. By carefully reviewing the certification of a product, consumers can make an informed decision about the drinking water treatment device that will provide the performance they need.

NSF Listings by Standard		
By Standard	Products	Companies
Aesthetics, Standard 42	3442	155
Health Effects, Standard 53	1033	87
Reverse Osmosis, Standard 58	676	78
Distillation, Standard 62	0	0
Total	5151	320

NSF Listings by Contaminant				
By Single Contaminants	Number of Products			
	Health Effects	Reverse Osmosis	Distillers	Total
PCB	89	0	0	89
Chloramine	99	0	0	99
Arsenic	20	147	0	167
VOC	183	14	0	197
MTBE	225	4	0	229
Mercury	386	0	0	386
Asbestos	492	24	0	516
Lead	595	185	0	780
Cyst	867	168	0	1035
Chlorine	1654	0	0	1654

NSF Listings by Combinations of Contaminants				
By Combination of Contaminants	Number of Products			
	Health Effects	Reverse Osmosis	Distillers	Total
Cyst, Lead	480	167	0	647
Cyst, Lead, Mercury	281	0	0	281
Cyst, Lead, Mercury, Asbestos	250	0	0	250
Cyst, Lead, Mercury, Asbestos, MTBE	166	0	0	166
Cyst, Lead, Mercury, Asbestos, MTBE, VOC	93	0	0	93
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB	77	0	0	77
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramine	77	0	0	77
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramines, Arsenic V	20	0	0	20

All 20 models
Multi-Pure

Charts are based on NSF online listings on April 3, 2006.
For more information, go to NSF International website: www.nsf.org



Multi-Pure Drinking Water Systems

The Las Vegas Technology Center
7251 Cathedral Rock Drive
Las Vegas, NV 89128
866-622-9373
www.multipureplus.com